

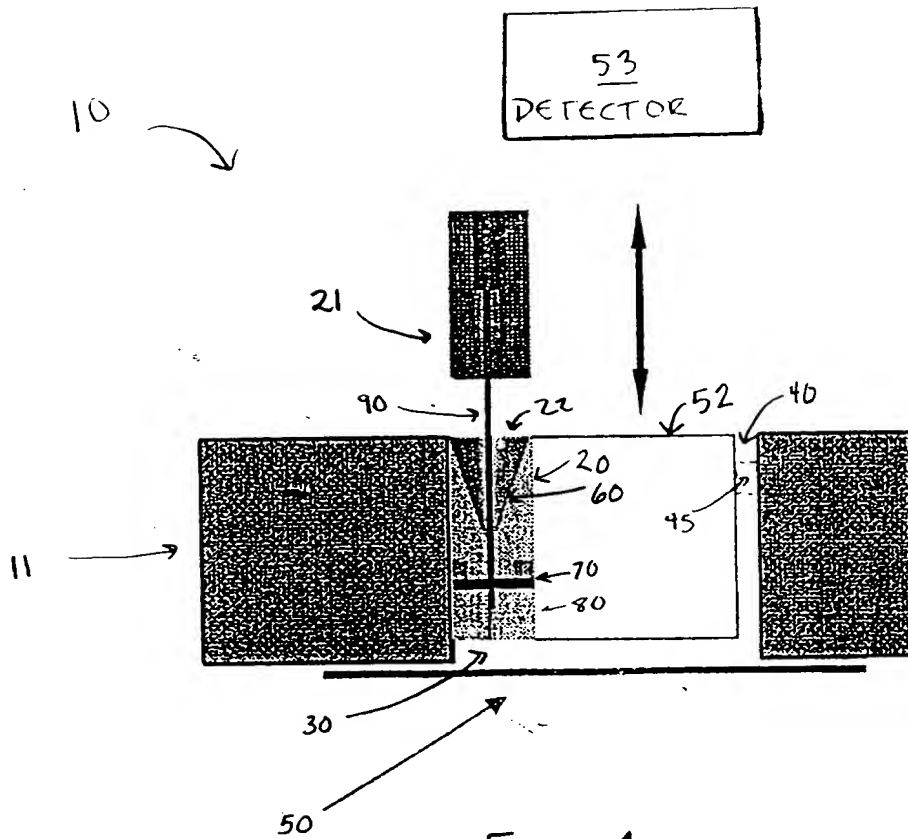
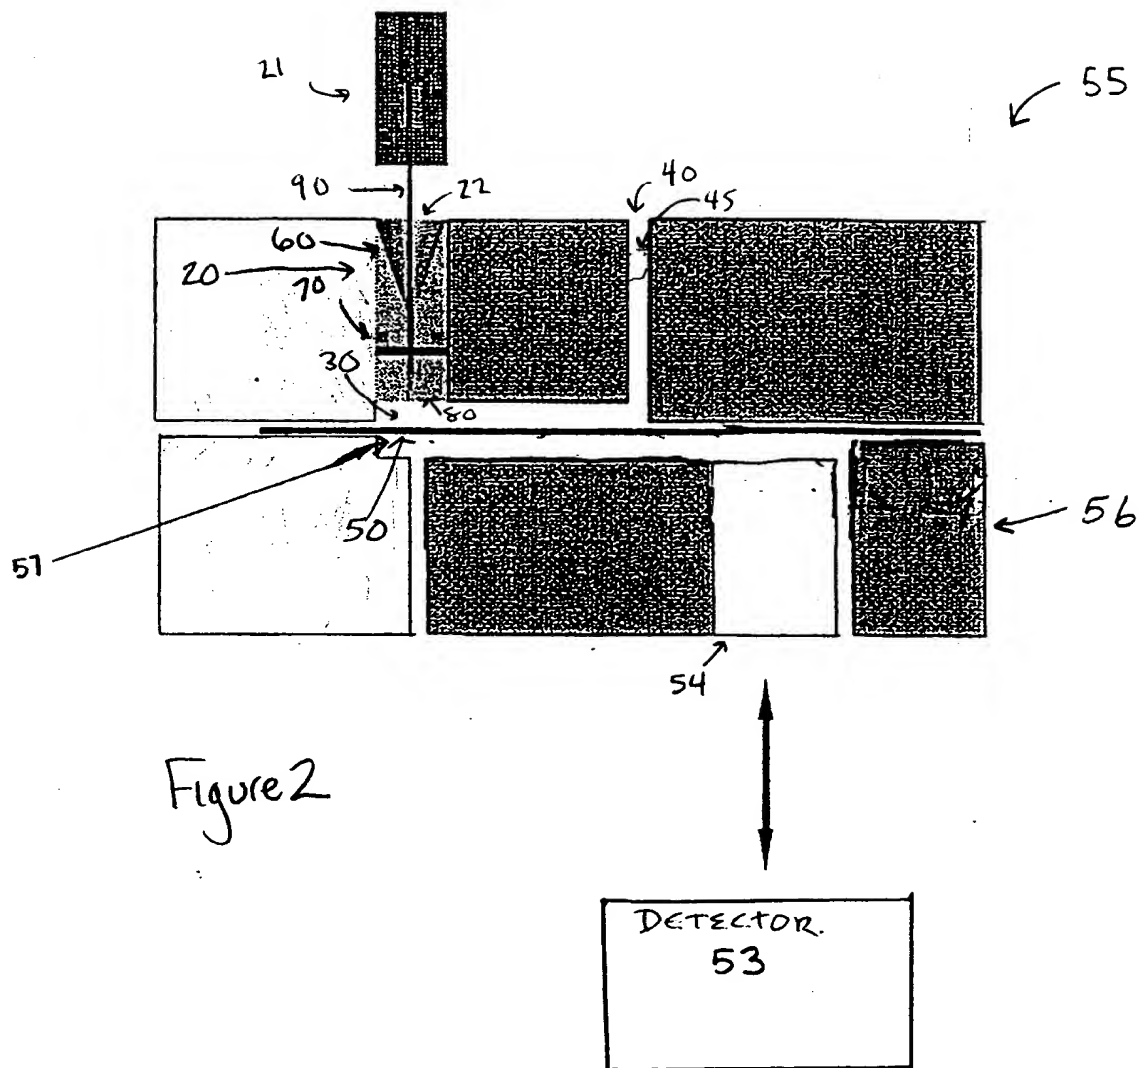
[illegible]

Figure 1

FIG. 2



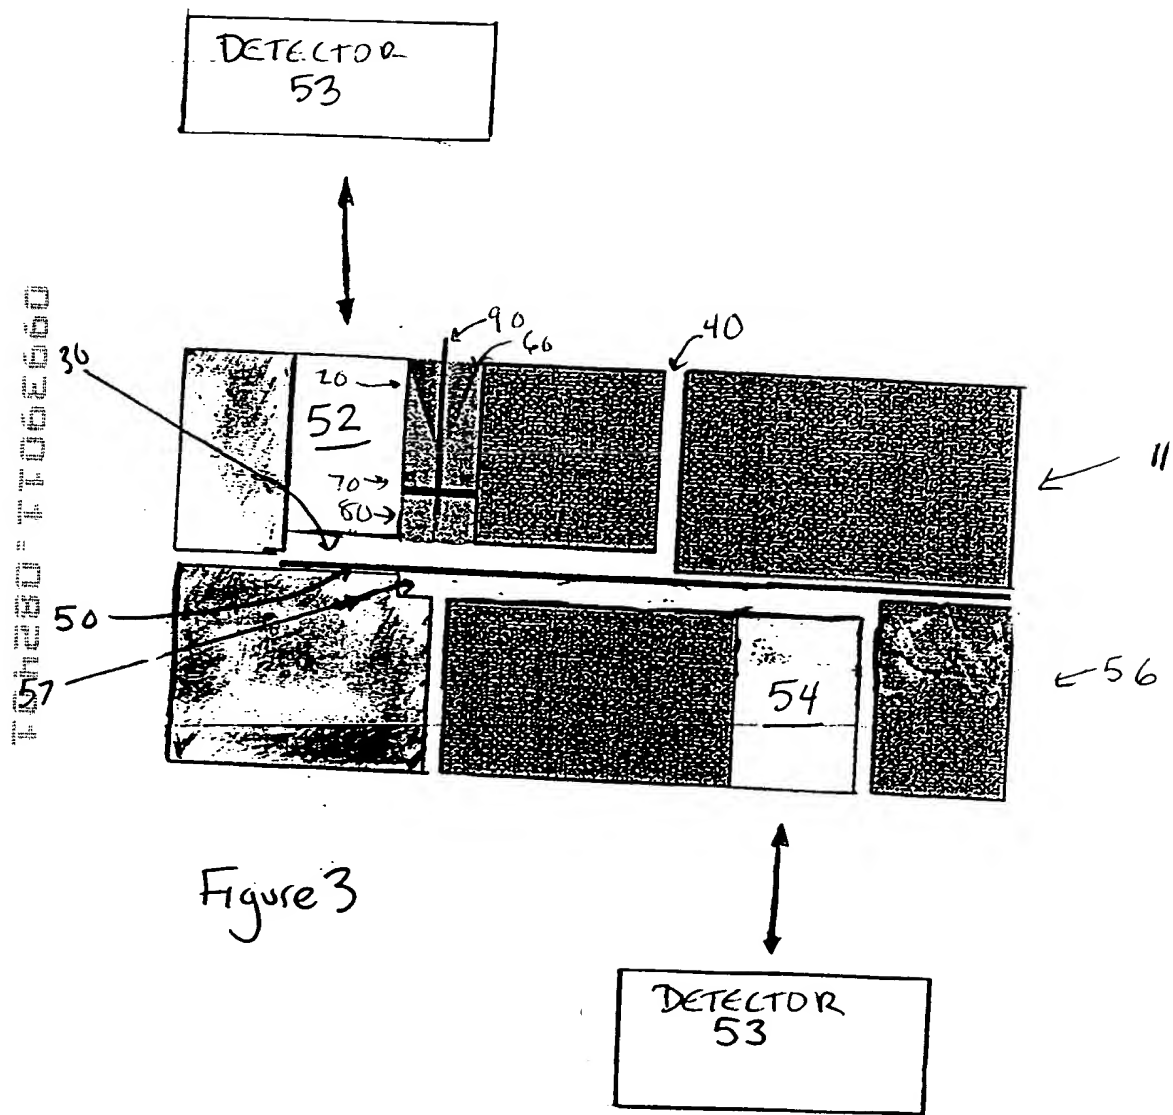


Figure 3











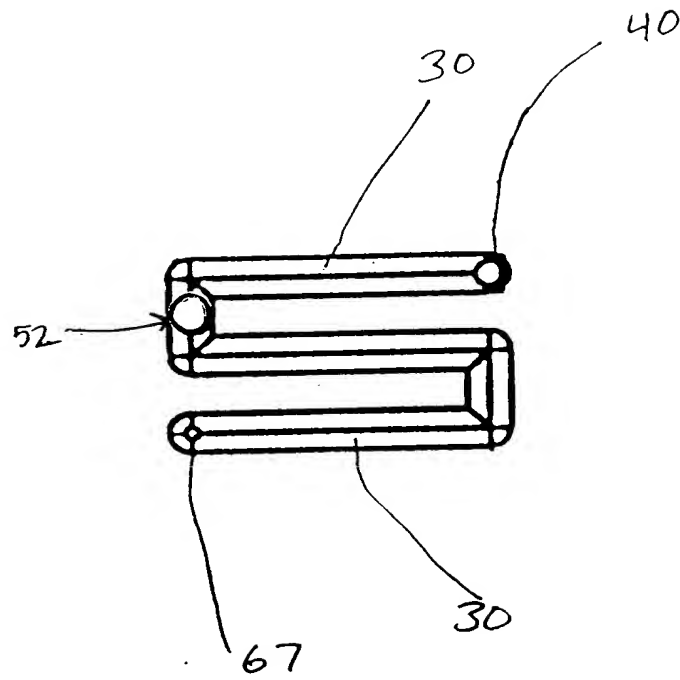
Initial Sample	Dialysate, 15 min	Dialysate, 20 min	Sample, 45 minutes	Sample, 60 minutes	
					Wild-type Sample (Incorporated Labels)
					Mutant-type Sample (Clipped Labels)

Figure 4

FIGURE 5



0939011-082401
104280-106660

FIGURE 6

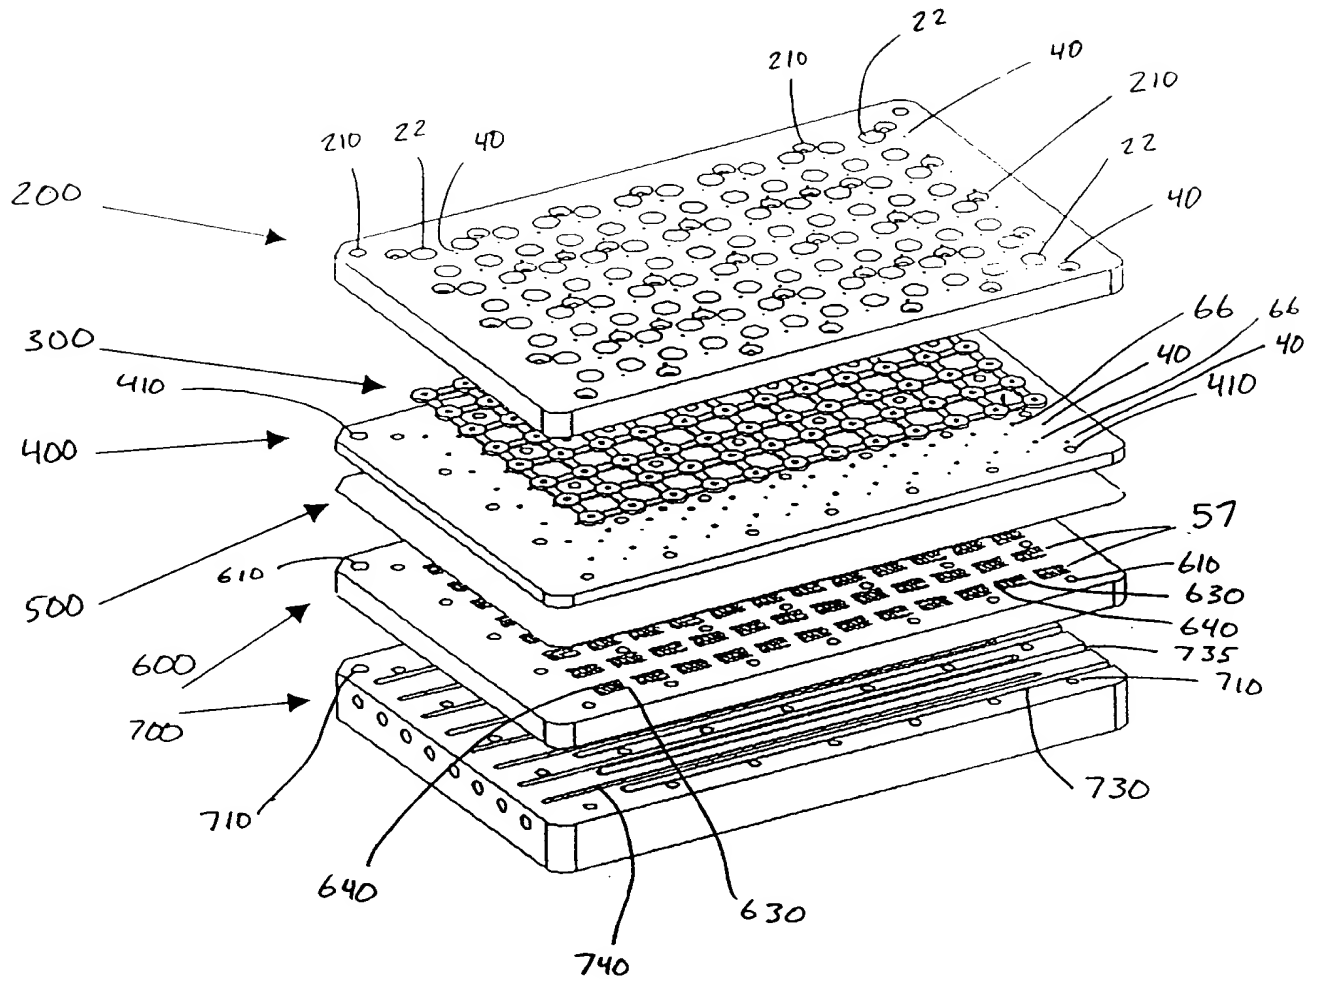


FIGURE 7


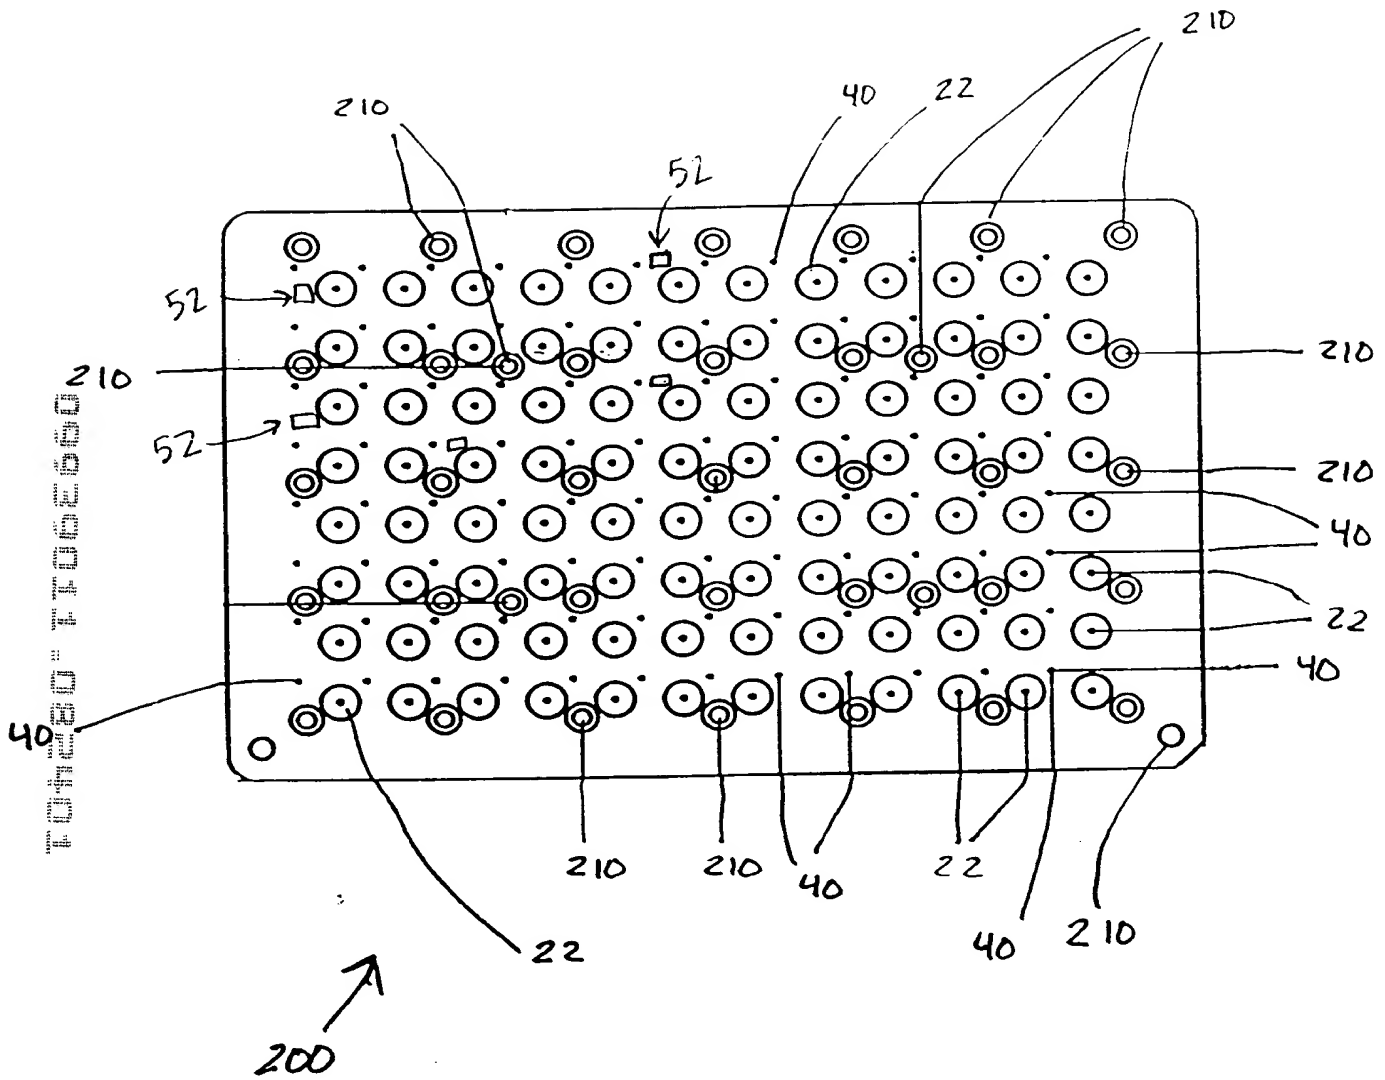


FIGURE 8

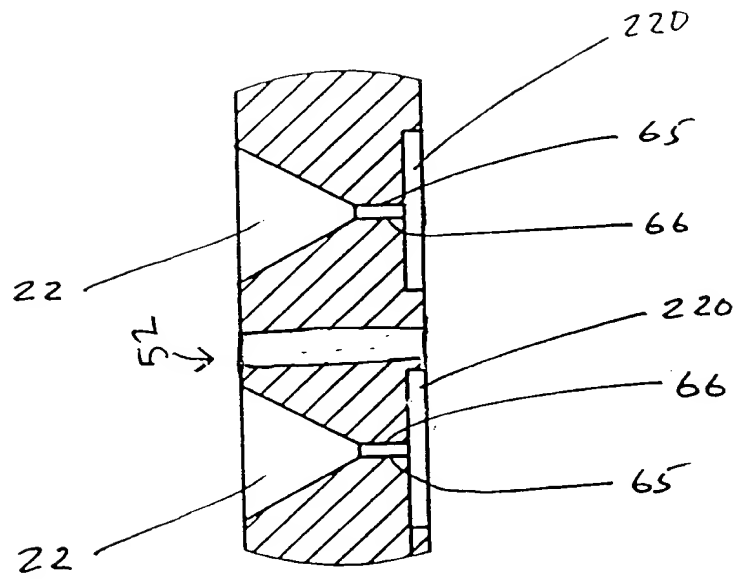

09232011 082404
FOH280 T06E660

FIGURE 9

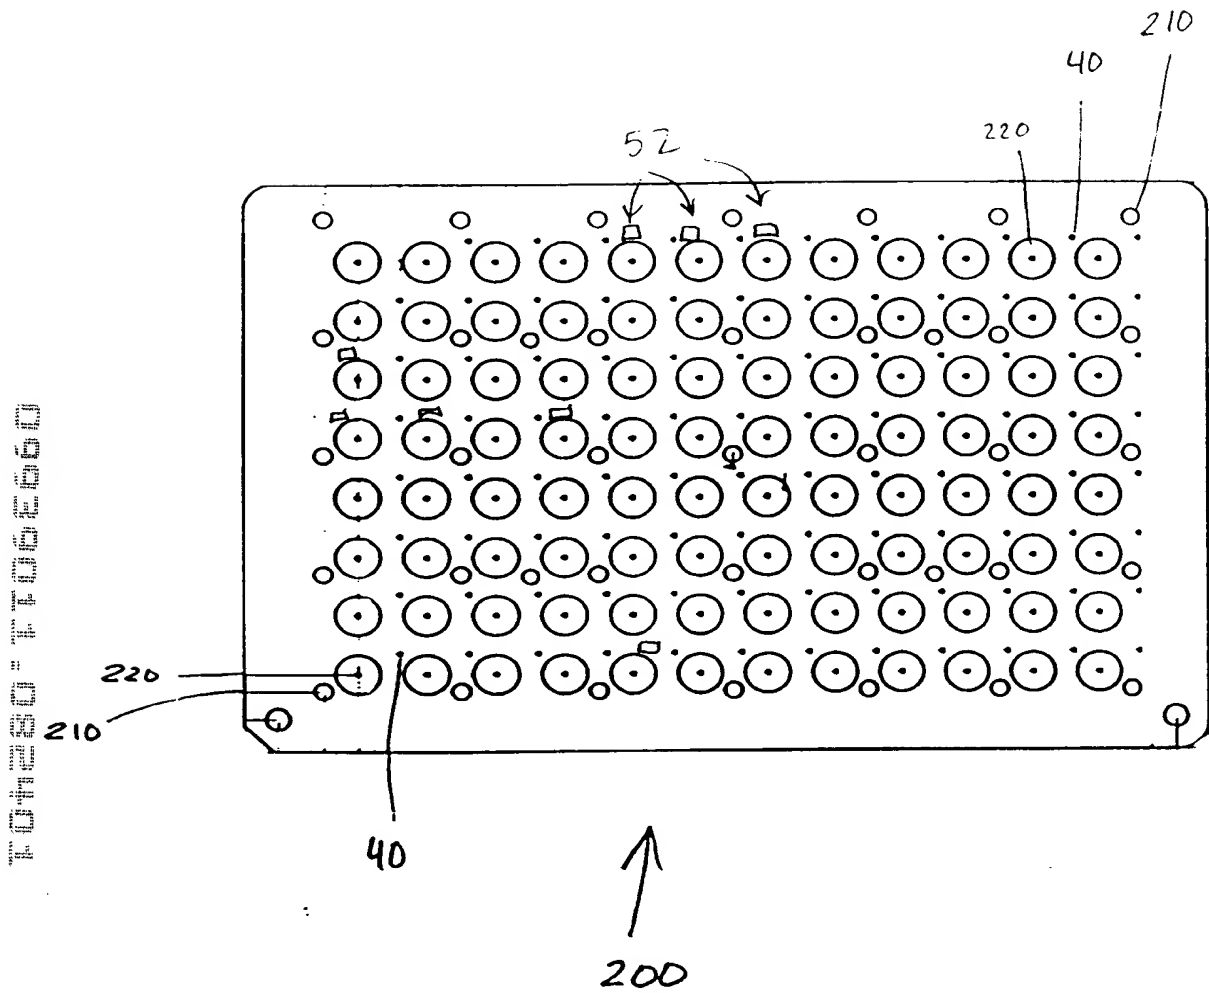


FIGURE 10

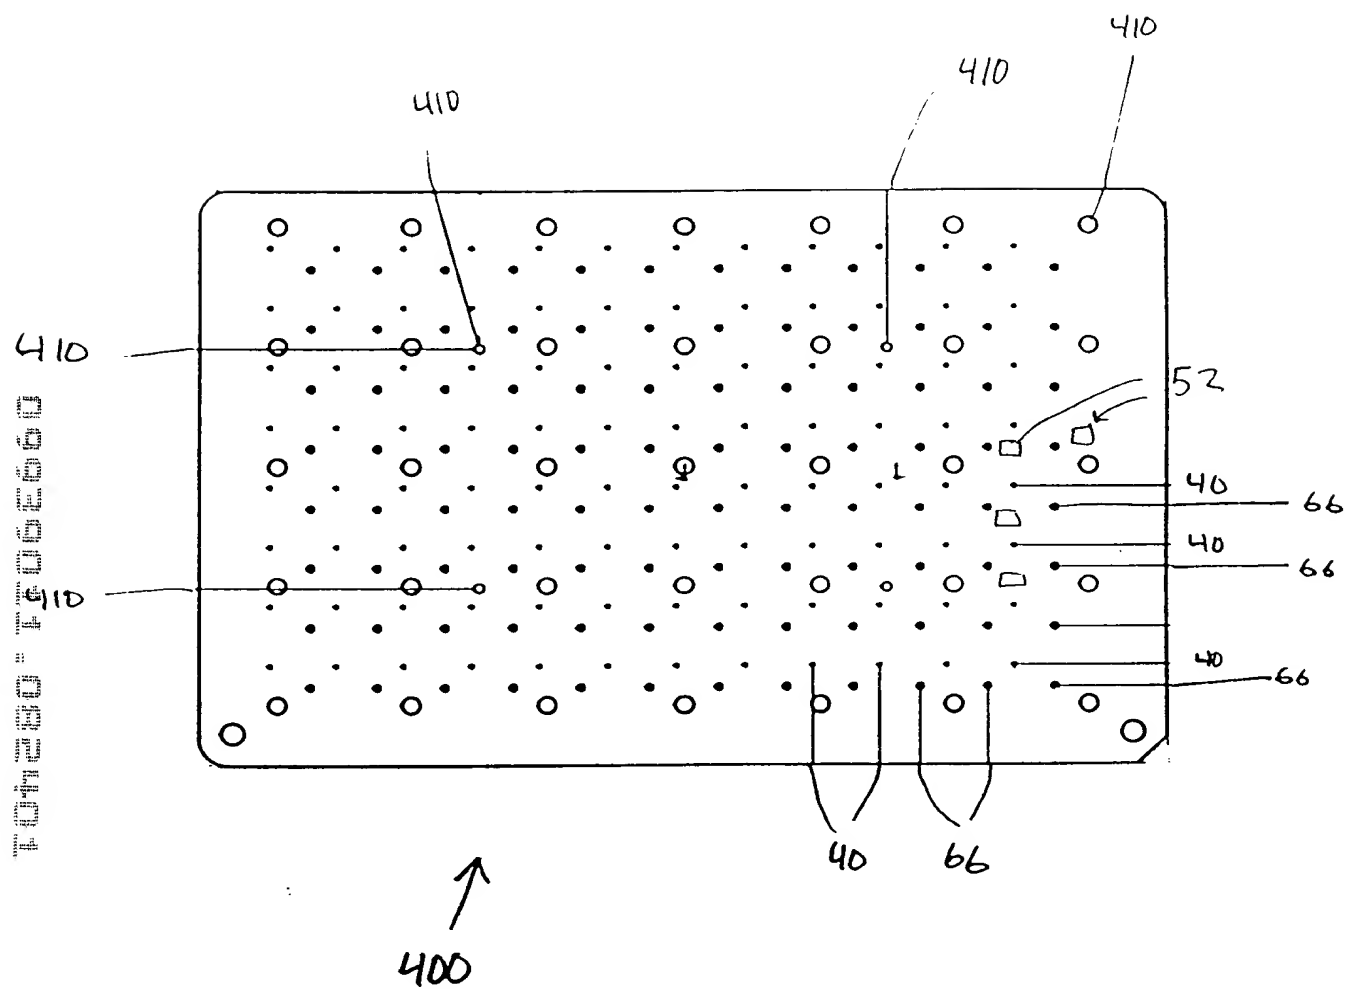


FIGURE 11


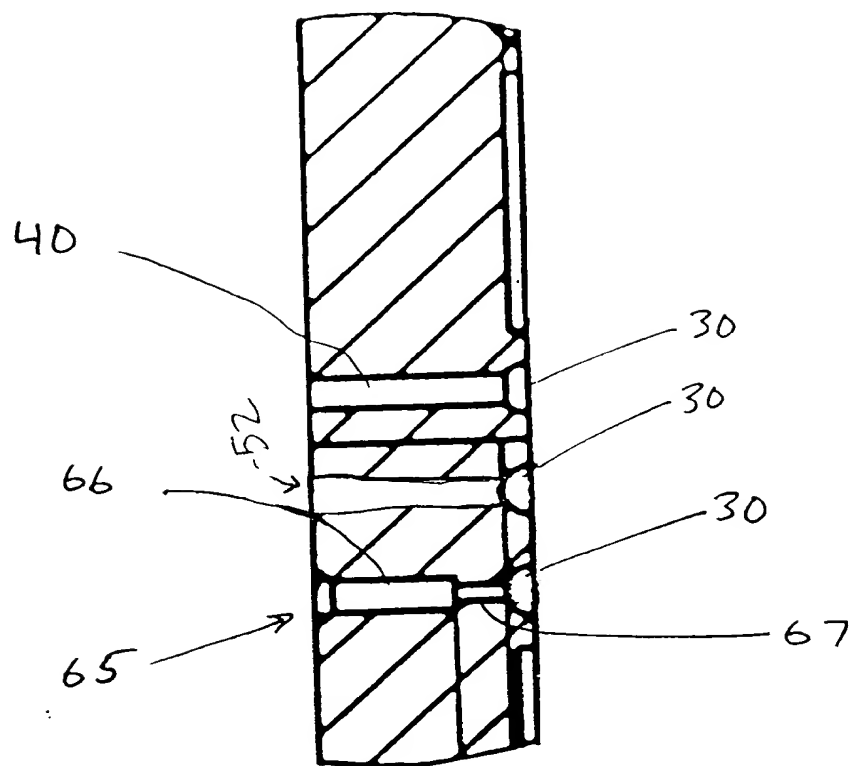


FIGURE 12

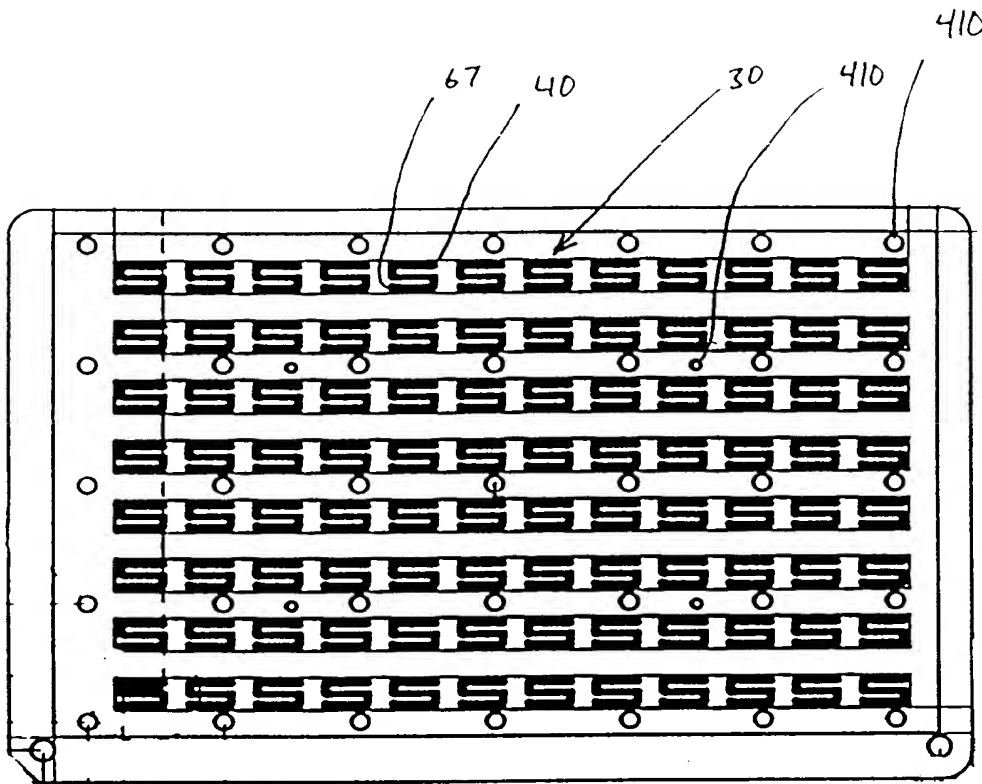

400

FIGURE 12

FIGURE 13

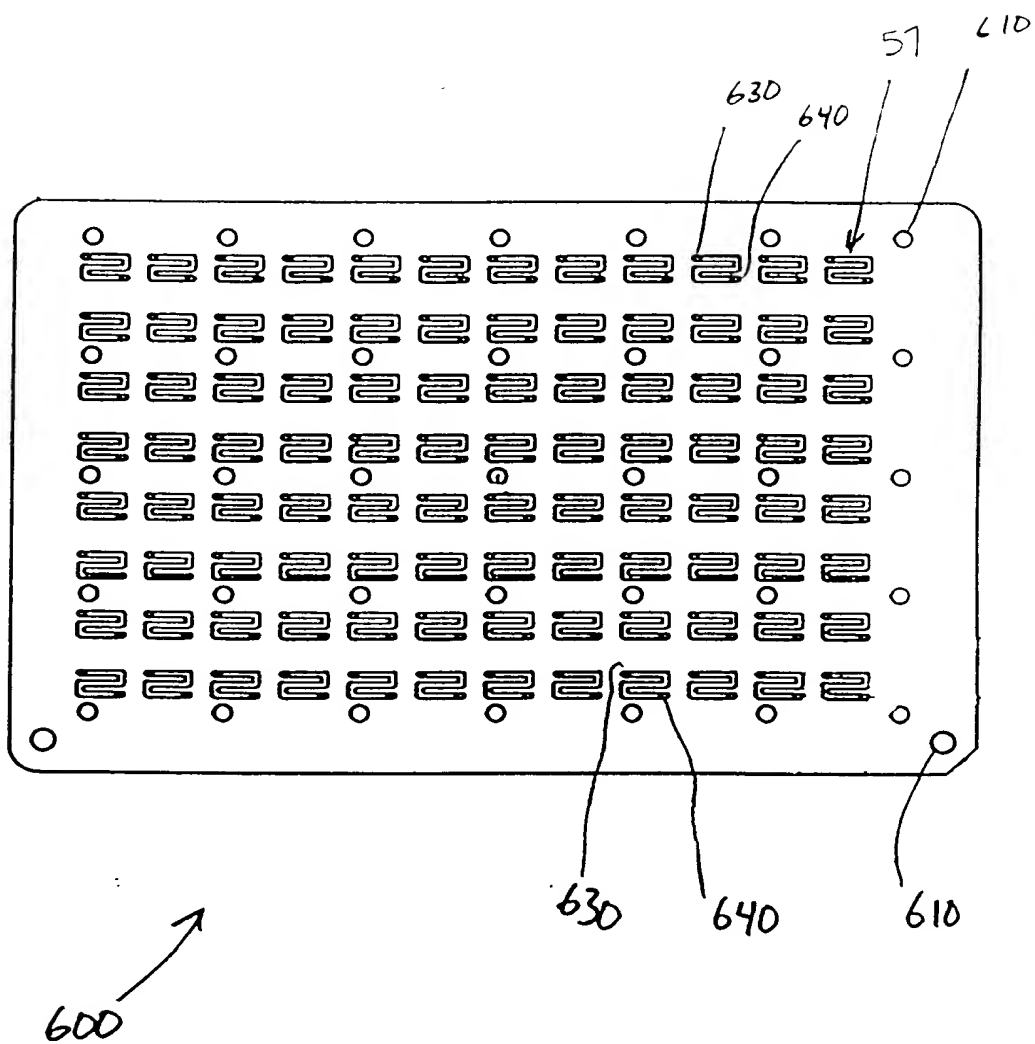


FIGURE 14

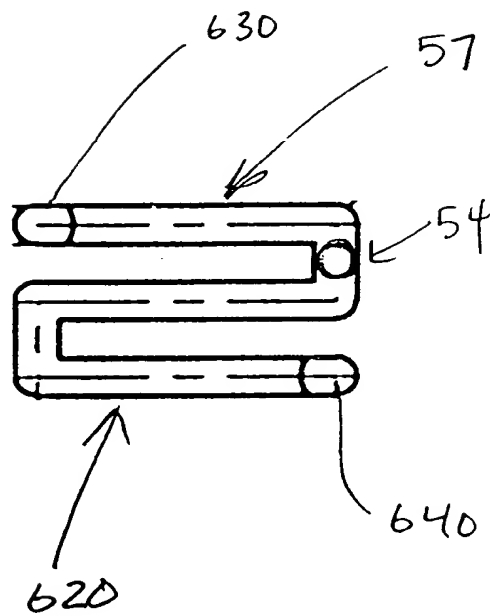


FIGURE 14

FIGURE 15

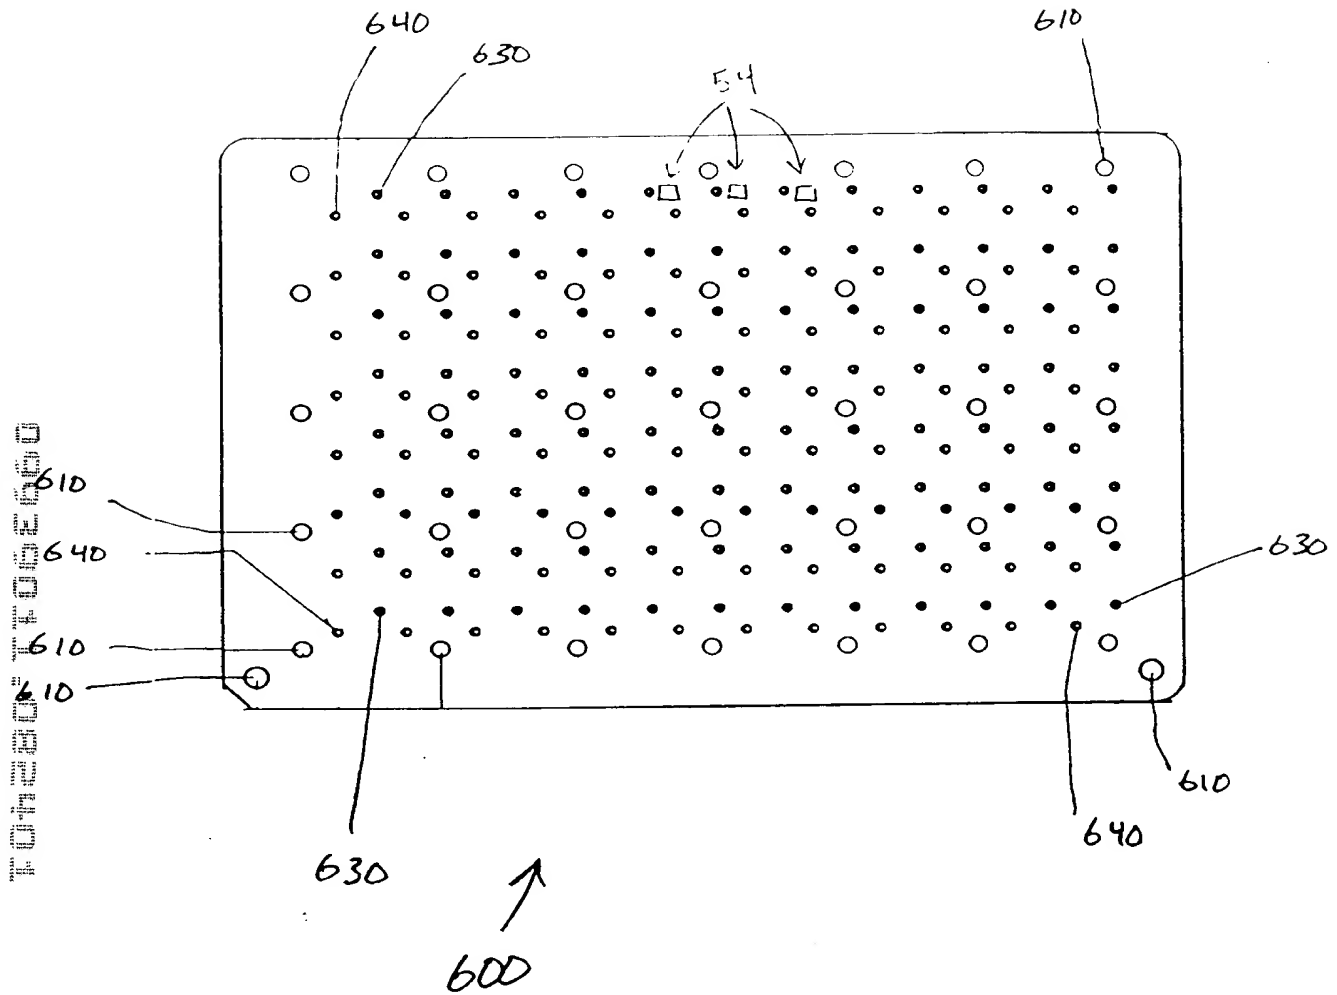


FIGURE 16

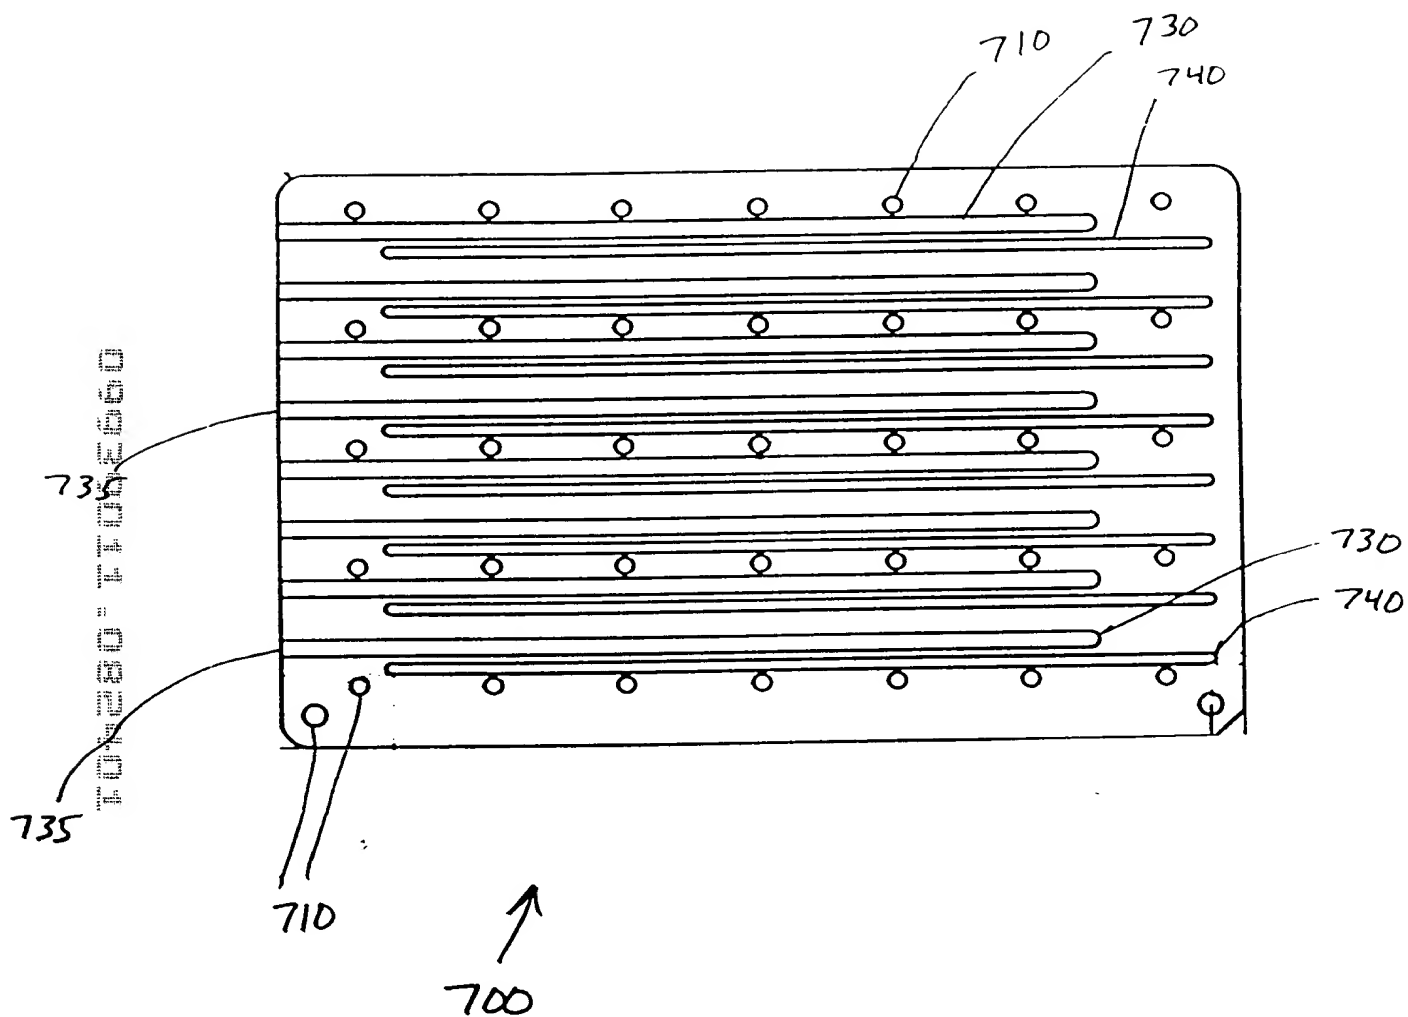


FIGURE 17

